

Loughborough University  
Institutional Repository

---

*Dynamic behaviour of  
multi-terminal VSC-based  
HVDC after a converter  
outage: DC control strategy*

This item was submitted to Loughborough University's Institutional Repository by the/an author.

**Citation:** GONZALEZ-LONGATT, F., ARNALTES-GOMEZ, S. and RODRIGUEZ-AMENEDO, J., 2016. Dynamic behaviour of multi-terminal VSC-based HVDC after a converter outage: DC control strategy. *Renewable Energy and Power Quality Journal*, 14 (May), article no. 266.

**Additional Information:**

- Originally presented at: International Conference on Renewable Energies and Power Quality (ICREPQ 16), Madrid, Spain, 4-6 May, 2016.

**Metadata Record:** <https://dspace.lboro.ac.uk/2134/21537>

**Version:** Published

**Publisher:** © EA4EPQ

**Rights:** This work is made available according to the conditions of the Creative Commons Attribution-NonCommercial-NoDerivatives 4.0 International (CC BY-NC-ND 4.0) licence. Full details of this licence are available at: <https://creativecommons.org/licenses/by-nc-nd/4.0/>

Please cite the published version.



## Dynamic Behaviour of Multi-Terminal VSC-Based HVDC after a Converter Outage: DC Control Strategy

F. Gonzalez-Longatt<sup>1</sup>, S. Arnaltes<sup>2</sup>, J.L. Rodríguez-Amenedo<sup>2</sup>

<sup>1</sup> The Wolfson School: Electronic, Electrical and Systems Engineering, Loughborough University, Loughborough, LE113TU (United Kingdom)

Phone/Fax number: +44(0)150 9227061, e-mail: [fglongatt@fglongatt.org](mailto:fglongatt@fglongatt.org)

<sup>2</sup> Escuela Politécnica Superior, Universidad Carlos III de Madrid, C/ Butarque 15, 28911 Leganés (Spain)

Phone: +34 - 91 624 9911, fax: +34 - 91 624 9430, e-mail: [santiago.arnaltes@uc3m.es](mailto:santiago.arnaltes@uc3m.es), [amenedo@ing.uc3m.es](mailto:amenedo@ing.uc3m.es)

### Abstract.

The aim of this paper is to evaluate the effect of DC-voltage control strategy on the dynamic behaviour of multi-terminal Voltage-Source Converter (VSC)-Based HVDC after a converter outage. In this paper, two dc voltage control strategies are considered: (i) *standard voltage margin method* (SVMM) and (ii) *standard voltage-droop method* (SVDM). The impact is evaluated in this paper using time-domain simulations on a simple test system using DIgSILENT<sup>®</sup> PowerFactory<sup>™</sup> considering a sudden disconnection of a converter-station. Simulation results demonstrate how important is the dc-voltage control strategy and the location/number of dc-buses involved in the dc-voltage on the dynamic response of the MTDC systems. The voltage margin control is capable of surviving a converter outage just if this converter is operating in constant power mode.

### Key words

Dynamic response, multi-terminal HVDC, MTDC, Voltage Source Converters.

### 1. Introduction

European Union (EU) has imposed a dramatic reduction of CO<sub>2</sub> emissions, for such purpose, it is required a massive reduction of emission in electricity generation sector, as a consequence, it is really important to maximize the power contribution coming from offshore wind power plants distant from the shore. Dc networks look quite attractive for the network integration of this clean energy [1, 2]. *Voltage Source Converter (VSC) High Voltage DC* (HVDC) transmission systems empower the usage of more elaborate configurations such as the *Multi-terminal VSC-HVDC* (MVSCDC) networks. It offers higher reliability, redundant and flexible technology to enable the massive integration of offshore wind power in future power systems [3].

Outstanding efforts on the research on MTDC have been developed in several areas in recent times. A quite a number of publications are devoted to several subject of MTDC involving since the classical steady state

performance [4-8], classical and security constrained optimal power flow [7, 9-11], modelling [12-14], control and protection [15-20], and simulation of dynamic behaviour [4, 21-24]. An aspect that requires evaluation, the traditional reliability and availability related to outages as to transient reliability related to performance during and recovery after temporary faults and disturbances. Cable and converter station outages create a serious risk of instability in hybrid ac/dc network because to a large amount of power transmitted by MTDC system. Dc voltage control is the vital aspect that indicates the power balance and the stability of an MTDC system.

The objective of this paper is to evaluate the impact of the dc voltage control strategies on the dynamic behaviour of multi-terminal VSC-based HVDC following a converter outage, two strategies are analysed in this paper: *Standard Voltage Margin Method* (SVMM) and *Standard Voltage Droop Method* (SVDM). Section 2 presents a general introduction to the main control systems in MTDC systems and presents the theoretical background of dc voltage strategies. Section 3 shows the simulations results and discussion about the impact of the dc voltage control strategies on the dynamic behaviour of multi-terminal VSC-based HVDC following a converter outage. Finally, Section 4 concludes. The contribution of this paper includes: (i) demonstrates bipolar configuration can provide minimal voltage deviation from the initial nominal voltage than mono-polar network (ii) bipolar configuration (small dc voltage droops) allow the operation within the rated voltage limits.

### 2. Control of MTDC Systems

The control schemes have a large impact on system dynamics. It is an important task to determine the modelling requirements of the control schemes. The control system for a MTDC is composed of two different layers of controllers [25]: (i) *terminal controllers* and (ii) a *master controller* as illustrated in Fig. 1.


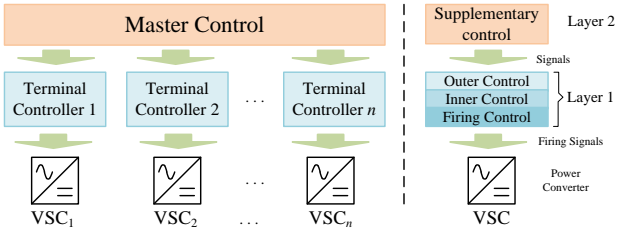



Fig. 1. Schematic representation of MTDC control system hierarchy [25].

The *master controller* is provided with a minimum set of functions necessary for the coordinated operation of the terminals and the terminal controllers (outer controllers) are mainly responsible for active power control, reactive power control, dc voltage regulation, and ac voltage regulation. The *current controller loop* is the inner and faster part of the cascaded control strategy. This control produces the firing signals from the current reference values ( $i_d^*$ ,  $i_q^*$ ) received from the outer controllers and  $dq$  transformed currents from transducer devices ( $i_d$ ,  $i_q$ ).

Dc voltage control is certainly one of the most important tasks given to the VSC-HVDC stations inside a MTDC network. A well-controlled dc voltage on a MTDC system is a guarantee of the power balance between all the interconnected nodes. Considering the operational requirements for dc voltage on MTDC, the literature provides two main control strategies which possibly can be applied in future transnational networks [26]: (i) *Standard Voltage Margin Method* (SVMM) and (ii) *Standard Voltage Droop Method* (SVDM). These methods enable sharing of load among two or more dc voltage regulating terminals operating in parallel and provide controls in MTDC.

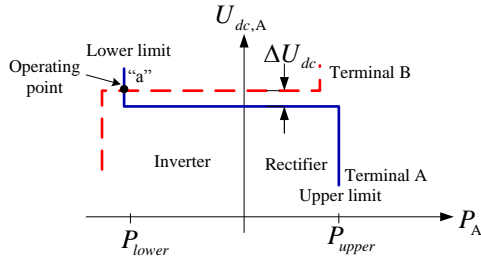

(a)  $U_{dc}$ - $P$  characteristic showing the operating point "a" in VMM for one terminal

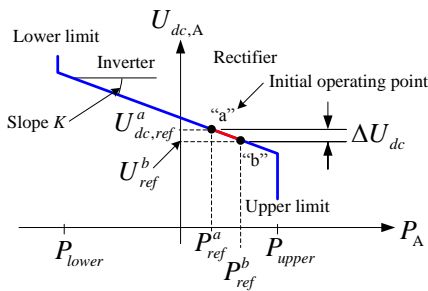

(b)  $U_{dc}$ - $P$  characteristic showing the operating point "a" in SVDM for one terminal.

Fig. 2. General  $U_{dc}$ - $P$  characteristic of dc voltage control strategies.

The SVMM is defined as the difference between the dc reference voltages of the two terminals [27-29]. Fig. 2(a) shows the  $U_{dc}$ - $P$  characteristics of both terminals at Terminal A, the intersection  $U_{dc}$ - $P$  of the characteristics of each terminal is the operating point "a". The dc voltage-

droop,  $K$ , indicates the degree of compensation of power unbalances in the dc network at a cost of a reduction in the dc bus voltage. This principle of SVDM control is shown in Fig. 2(b).

### 3. Simulation and Results

In this paper, the dynamic behaviour of a MTDC system after the loss of a converter station is analysed. Time-domain simulations are based on a hybrid ac/dc system. The ac networks are based on the classical 5-node test network taken from the book of Stagg and El-Abiad [30], for illustrative purposes the dc network is a 4-node VSC MTDC network. It consists of 4 VSC stations tied together by 5 dc submarine transmission cables rated at 150 kV describing a parallel multi-terminal HVDC. DlgSILENT PowerFactory™ [31] is used to perform the time-domain simulations, the model of all controllers are developed using *DIgSILENT Simulation Language* (DSL).

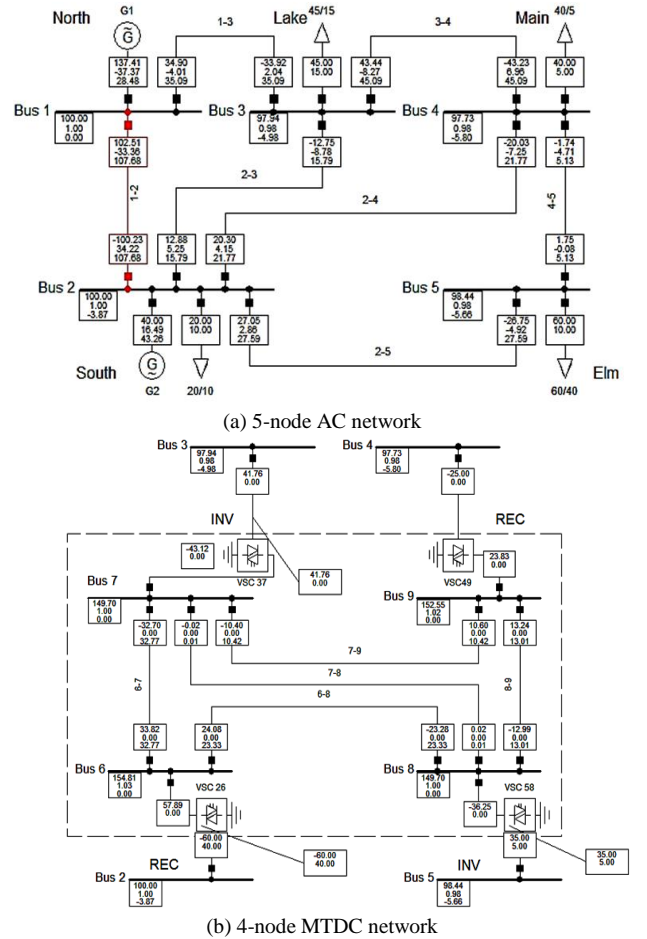



Fig. 3. Steady state condition for the hybrid ac/dc test network.

Two dc network configurations are studied in this section: (i) *mono-polar network configuration* and (ii) *bipolar network configuration*. Two dc voltage control strategies are considered in this paper: (i) *Standard Voltage Margin Method* (SVMM) and (ii) *Standard Voltage Droop Method* (SVDM). Seven cases are evaluated: *Case I*: The converter station VSC37 is chosen as dc slack-bus when the VMM is used, thereby controlling the voltage on the dc network. Converter stations VSC26, VSC58, VSC49 converter stations are


directly controlling their reactive power injections (constant  $P$ -mode). The converter station VSC37 is also used to control the voltage at bus 3 ( $U_3 = 0.98$  pu). *Case II*: This case considers the use of multiple dc slack buses, in this case, all converter stations are using controller based on SDVDM considering  $K = -1.00$ . *Case III*: It is similar to Case II but it consider  $K = -3.00$ , *Case IV*:  $K = -4.00$ , *Case V*:  $K = -6.00$ , *Case VI*:  $K = -0.50$  and *Case VII*:  $K = -0.20$ . A single contingency is considered where outage converter station is VSC37.

#### A. Mono-polar Network Configuration


The plot of  $U_{dc}$  versus  $P_{dc}$  of the *Cases I-VII* following a sudden disconnection of VSC37 are shown in Fig. 3. Results shows that there is some level of control coupling between the converter terminals using SVM and SDVDM.

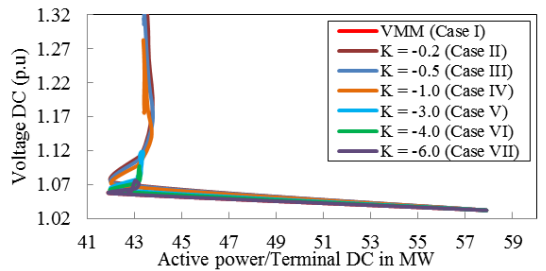


(a) VSC26

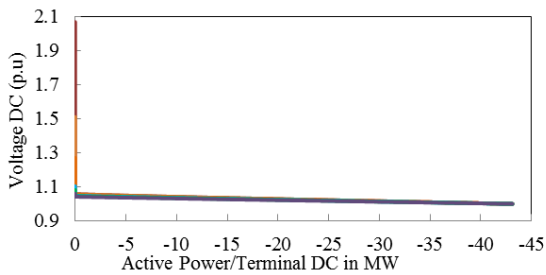

(b) VSC37

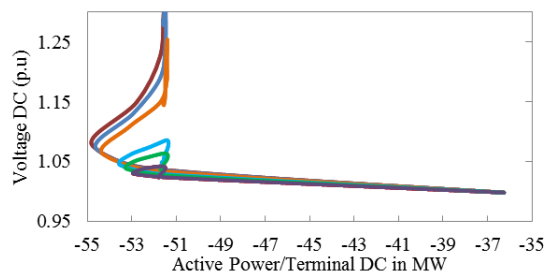

(c) VSC58

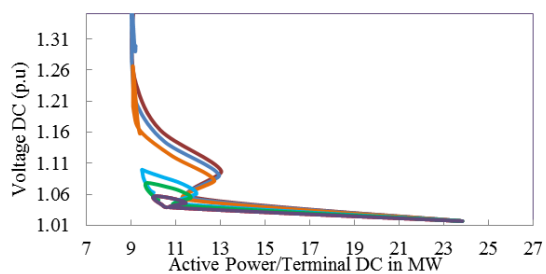

(d) VSC49

Fig. 3. Simulation results:  $U_{dc}$ - $P_{dc}$  plot of several Cases. Mono-polar Network Configuration.

On dc bus 6, *Case II* ( $K = -0.2$ ) attains the highest maximum instantaneous voltage value of 2.0761 pu at 0.30 sec taking a longer period of time to peak. *Case VII* where  $K = -6.00$  takes shorter time of 0.15 sec to reach the

maximum instantaneous voltage on the dc buses having its lowest values 1.0759 pu on bus 6. *Case I* shows the lowest variation of steady state voltage at 1.0376 pu and *Case II* have the highest variation of 1.6885 pu.

It can be concluded that the slope  $K$  in droop control influences the voltage response in the system such that, the smaller the slope value, the lower the peak value attained and the faster time it takes to peak having low variation from steady state voltage. There is power imbalance resulting from the converter outage, however, the power produced is shared between the terminals having the same droop characteristics provided the terminals have enough capacity to compensate the power unbalance. *Case I* using VMM shows the highest variation of steady state power flow because only one converter is capable of controlling the dc voltage in the system at a time ( $U_{dc}$ - $Q$  mode) with the other converters controlling active power ( $P$ - $Q$ ).

Table I shows the percentage of change resulting from the converter outage on other buses. The lowest voltage change is in *Case I* and for droop controller as the  $K$  values get smaller, the voltage change decreases (where  $K = -0.40$  and  $-0.60$  showed low changes in value).

Table I. Percentage of dc voltage change (%) after sudden disconnection of VSC37 for Mono-polar Network

Bus	Case						
	I	II	III	IV	V	VI	VII
6	3.21	68.85	31.47	17.68	8.198	5.78	5.78
7	0.21	67.73	30.03	16.07	6.46	4.03	4.03
8	0.21	67.73	28.68	14.56	4.81	2.34	2.34
9	1.68	67.58	29.86	15.89	6.31	3.92	3.92

From Table I, *Case II* ( $K = -0.2$ ) has very high percentage change in dc voltage and as the slope value decreases, the percentage change also decreases. It can be deduced that a system is prone to imbalance when operating large slope constants in droop control implying that a small slope  $K$  value results in greater sensitivity to dc bus voltage at the expense of larger deviations of power flow from the nominal power, however, this will allow for a stronger dc network. *Case I* maintained the lowest voltage change, voltages on buses 7 and 8 decreased to 149.6 kV, 0.21% less than controlled nominal voltage. The dc cable power flows response of the *Cases I-VII* following a sudden disconnection of VSC37 are shown in Fig. 4.

Table II. Maximum instantaneous dc power flow transfer ( $P_{ij}$ ) in dc power cables in MW

Cable	Case						
	I	II	III	IV	V	VI	VII
6 - 7	21.33	18.32	18.21	18.13	18.01	18.35	18.36
6 - 8	31.52	25.49	25.31	25.27	25.22	25.48	25.49
7 - 8	22.52	17.59	17.37	17.30	17.21	17.66	17.72
7 - 9	-1.64	1.28	1.10	1.03	0.88	1.36	1.93
8 - 9	18.13	10.35	10.60	10.67	10.87	10.24	9.65

#### B. Bi-polar Network Configuration

Six instances, *Case II-VII*, are evaluated for the bipolar network in this paper. This considers the use of multiple dc slack buses, where all converter stations are using controller based on SVM. The following slope coefficient  $K$  for the droop control is considered *Case II-VII*:  $K = -0.20, -0.50, -1.00, -3.00, -4.00, \text{ and } -6.00$ .

Table II. Percentage of dc voltage change after sudden disconnection of VSC37: Bi-polar Network Configuration

Bus	Case					
	II	III	IV	V	VI	VIII
6	3.302	15.817	23.731	29.455	30.195	30.941
7	2.674	16.229	24.186	29.946	30.691	31.441
8	2.674	16.589	24.585	30.378	31.128	31.883
9	2.914	16.293	24.256	30.028	30.765	31.514

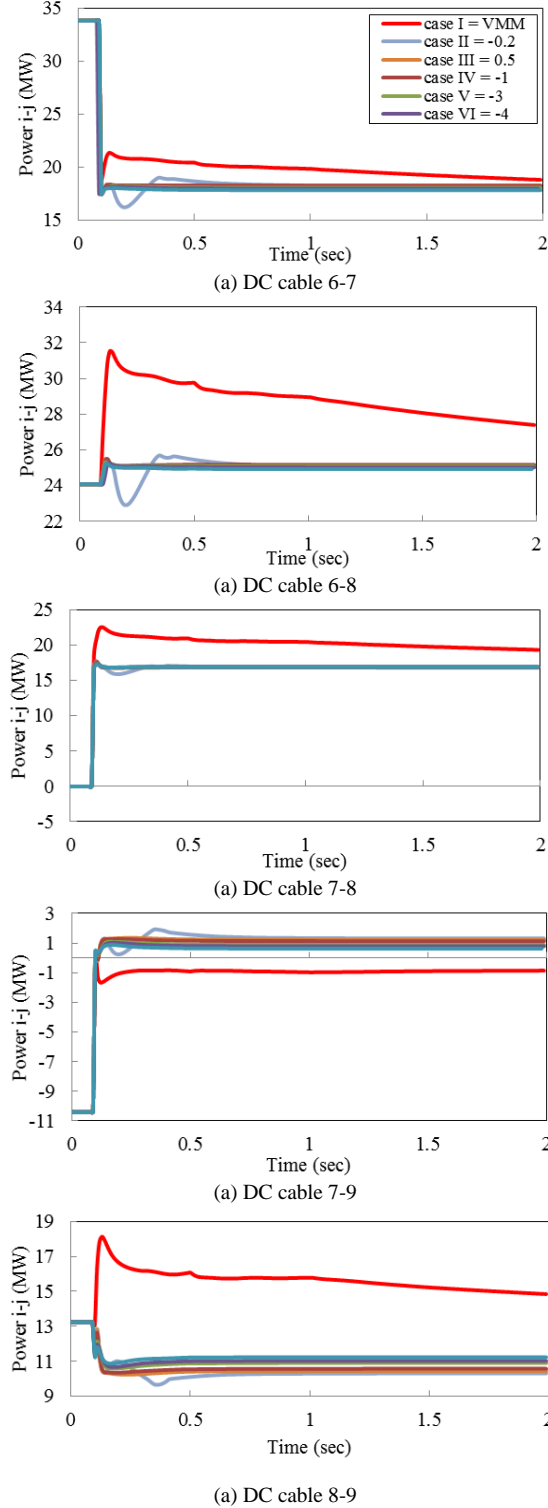


Fig. 4. Simulation results: power flows on dc submarine transmission cables for several simulation cases. Mono-polar Network Configuration.

From the Table II, Case II on dc bus 6 has the highest nominal voltage change of 3.30% from the rated nominal voltage. As the slope constant decreased, the voltages were

seen to be within the voltage limit. This is better understood looking at it from the maximum instantaneous voltage attained where  $K = -0.20$  reaches 1.720 pu which is 63.85 away from the rated nominal voltage.  $K = -6.00$  reached a max of 1.055 pu which is just 0.5% deviation from the rated voltage and is able to come back to steady state voltage of 1.035 pu quickly (recall the operation limit is max 1.050 pu). Simulation results show a level of power imbalance resulting from the converter outage, however; the excess power produced was successfully shared between the terminals having the same droop characteristics provided the terminals have enough capacity to compensate for the power unbalance.

#### 4. Conclusion

This paper evaluates the impact of the dc voltage control strategy on the dynamic behaviour of multi-terminal VSC-based HVDC following a Converter Outage, two strategies are analysed in this paper: SVM and SVM. Simulation results have shown that in the event of an outage of a converter station, there is a power imbalance in the MTDC network which is successfully distributed among the various converter terminals. The rate and efficacy of power balancing are however based on the control strategy and network configuration implemented. This was verified by the ability of converters using a smaller droop constant  $K$  in SVM to deliver a quicker response than those having a larger droop or using SVM scheme. A comparison of mono-polar and bipolar network showed that bipolar network delivered a better power stability with minimal voltage deviation from the initial nominal voltage than mono-polar network. Bipolar using smaller droops were seen to operate within the rated voltage limit and had 3.3% overvoltage for a larger droop constant. Also, results showed that power oscillations in the ac side are transferable to the dc side if a converter exceeds the rated current limit.

#### Acknowledgement

This work has been partially supported in part by British Council under the UKIERI, under grant DST/INT/UK/P-61/2014.

Table A. Numerical parameters of controller used at VSC stations in MTDC network.

VSC Station	Control	Controller Gain [pu]	Time Constant [sec]	Min. Current on q-d axis ( $I_{min}$ ) [pu]	Max. Current on q-d axis ( $I_{max}$ ) [pu]
VSC26	Q	$K_q = 3.00$	$T_q = 0.2$	-1.03	1.03
	P	$K_p = 1.00$	$T_p = 0.1$	-1.03	1.03
VSC37	Q	$K_q = 3.00$	$T_q = 0.2$	-1.03	1.03
	P	$K_p = 1.00$	$T_p = 0.1$	-1.03	1.03
VSC49	Q	$K_q = 1.00$	$T_q = 0.1$	-1.03	1.03
	P	$K_p = 1.00$	$T_p = 0.1$	-1.03	1.03
VSC58	Q	$K_q = 3.00$	$T_q = 0.2$	-1.03	1.03
	P	$K_p = 1.00$	$T_p = 0.1$	-1.03	1.03

Table B. Converter Set points.

Converter Station	Control Mode	Active Power Set point [MW]	Reactive Power Set point [MVAR]	Operation Mode
VSC37	$U_{dc}$ -Q	41.00	0.00	DC slack bus
VSC26	P-Q	-60.00	40.00	Rectifier
VSC58	P-Q	35.00	5.00	Inverter
VSC49	P-Q	-25.00	0.00	Rectifier



## References

- [1] F. Gonzalez-Longatt, "Optimal power flow in MTDC systems based on a DC-independent system operator objective," in *PowerTech, 2015 IEEE Eindhoven*, 2015, pp. 1-6.
- [2] F. Gonzalez-Longatt, "Optimal Steady-State Operation of a MTDC system based on DC-Independent System Operator Objectives," in *AC and DC Power Transmission, 11th IET International Conference on*, 2015, pp. 1-7.
- [3] F. Gonzalez-Longatt, "Optimal Power Flow in Multi-terminal HVDC Networks for DC-System Operator: Constant Current Operation," presented at the 50th International Universities Power Engineering Conference (UPEC 2015), Stoke-on-Trent, 2015.
- [4] J. Beerten, S. Cole, and R. Belmans, "Generalized Steady-State VSC MTDC Model for Sequential AC/DC Power Flow Algorithms," *Power Systems, IEEE Transactions on*, vol. 27, pp. 821-829, 2012.
- [5] J. Beerten, S. Cole, and R. Belmans, "Implementation aspects of a sequential AC/DC power flow computation algorithm for Multi-terminal VSC HVDC systems," in *AC and DC Power Transmission, 2010. ACDC. 9th IET International Conference on*, 2010, pp. 1-6.
- [6] M. E. El-Hawary and S. T. Ibrahim, "A new approach to AC-DC load flow analysis," *Electric Power Systems Research*, vol. 33, pp. 193-200, 1995.
- [7] E. Iggland, R. Wiget, S. Chatzivasilieadis, and G. Anderson, "Multi-Area DC-OPF for HVAC and HVDC Grids," *Power Systems, IEEE Transactions on*, vol. 30, pp. 2450-2459, 2015.
- [8] W. Wenyuan and M. Barnes, "Power Flow Algorithms for Multi-Terminal VSC-HVDC With Droop Control," *Power Systems, IEEE Transactions on*, vol. 29, pp. 1721-1730, 2014.
- [9] I. A. Calle, P. Ledesma, and E. D. Castronuovo, "Advanced application of transient stability constrained-optimal power flow to a transmission system including an HVDC-LCC link," *Generation, Transmission & Distribution, IET*, vol. 9, pp. 1765-1772, 2015.
- [10] J. Cao, W. Du, and H. F. Wang, "An Improved Corrective Security Constrained OPF for Meshed AC/DC Grids With Multi-Terminal VSC-HVDC," *Power Systems, IEEE Transactions on*, vol. 31, pp. 485-495, 2016.
- [11] A. Rabiee and A. Soroudi, "Stochastic Multiperiod OPF Model of Power Systems With HVDC-Connected Intermittent Wind Power Generation," *Power Delivery, IEEE Transactions on*, vol. 29, pp. 336-344, 2014.
- [12] H. Saad, T. Ould-Bachir, J. Mahseredjian, C. Dufour, S. Denneiere, and S. Nguefeu, "Real-Time Simulation of MMCs Using CPU and FPGA," *Power Electronics, IEEE Transactions on*, vol. 30, pp. 259-267, 2015.
- [13] N. T. Trinh, M. Zeller, K. Wuerflinger, and I. Erlich, "Generic Model of MMC-VSC-HVDC for Interaction Study With AC Power System," *Power Systems, IEEE Transactions on*, vol. 31, pp. 27-34, 2016.
- [14] D. Zonetti, R. Ortega, and A. Benchaib, "Modeling and control of HVDC transmission systems from theory to practice and back," *Control Engineering Practice*, vol. 45, pp. 133-146, 12// 2015.
- [15] F. D. Bianchi and J. L. Dominguez-Garcia, "Coordinated Frequency Control Using MT-HVDC Grids With Wind Power Plants," *Sustainable Energy, IEEE Transactions on*, vol. 7, pp. 213-220, 2016.
- [16] L. Hongzhi and C. Zhe, "Contribution of VSC-HVDC to Frequency Regulation of Power Systems With Offshore Wind Generation," *Energy Conversion, IEEE Transactions on*, vol. 30, pp. 918-926, 2015.
- [17] L. Luhui, Z. Jinwu, W. Chen, J. Zhuangxian, W. Jin, and C. Bo, "A Hybrid DC Vacuum Circuit Breaker for Medium Voltage: Principle and First Measurements," *Power Delivery, IEEE Transactions on*, vol. 30, pp. 2096-2101, 2015.
- [18] A. Raza, X. Dianguo, L. Yuchao, S. Xunwen, B. W. Williams, and C. Cecati, "Coordinated Operation and Control of VSC Based Multiterminal High Voltage DC Transmission Systems," *Sustainable Energy, IEEE Transactions on*, vol. 7, pp. 364-373, 2016.
- [19] M. Hajian, Z. Lu, and D. Jovcic, "DC Transmission Grid With Low-Speed Protection Using Mechanical DC Circuit Breakers," *Power Delivery, IEEE Transactions on*, vol. 30, pp. 1383-1391, 2015.
- [20] D. Jovcic, M. Taherbaneh, J. P. Taisne, and S. Nguefeu, "Offshore DC Grids as an Interconnection of Radial Systems: Protection and Control Aspects," *Smart Grid, IEEE Transactions on*, vol. 6, pp. 903-910, 2015.
- [21] R. Eriksson, "Coordinated Control of Multiterminal DC Grid Power Injections for Improved Rotor-Angle Stability Based on Lyapunov Theory," *Power Delivery, IEEE Transactions on*, vol. 29, pp. 1789-1797, 2014.
- [22] Z. Jiebei, J. M. Guerrero, W. Hung, C. D. Booth, and G. P. Adam, "Generic inertia emulation controller for multi-terminal voltage-source-converter high voltage direct current systems," *Renewable Power Generation, IET*, vol. 8, pp. 740-748, 2014.
- [23] L. Sheng, X. Zheng, H. Wen, T. Geng, and X. Yinglin, "Electromechanical Transient Modeling of Modular Multilevel Converter Based Multi-Terminal HVDC Systems," *Power Systems, IEEE Transactions on*, vol. 29, pp. 72-83, 2014.
- [24] W. Wenyuan, A. Beddard, M. Barnes, and O. Marjanovic, "Analysis of Active Power Control for VSC&#x2013;HVDC," *Power Delivery, IEEE Transactions on*, vol. 29, pp. 1978-1988, 2014.
- [25] F. Gonzalez-Longatt, J. M. Roldan, J. Rueda, C. A. Charalambous, and B. S. Rajpurohit, "Implementation of Simplified Models of Local Controller for Multi-terminal HVDC Systems in DiGSILENT PowerFactory," in *PowerFactory Applications for Power System Analysis*, F. M. Gonzalez-Longatt and J. Luis Rueda, Eds., ed: Springer International Publishing, 2014, pp. 447-472.
- [26] F. Gonzalez-Longatt, J. Roldan, M. Burgos-Payán, and V. Terzija, "Implications of the DC Voltage Control Strategy on the Dynamic Behavior of Multi-terminal HVDC following a Converter Outage," presented at the CIGRE-UK and European T&D network solutions to the challenge of increasing levels of renewable generation, Newcastle-under-Lyme College, Staffordshire, United Kingdom, 2012.
- [27] F. Gonzalez-Longatt and J. M. Roldan, "Effects of dc voltage control strategies of voltage response on multi-terminal HVDC following a disturbance," in *Universities Power Engineering Conference (UPEC), 2012 47th International*, 2012, pp. 1-6.
- [28] T. M. Haileselassie and K. Uhlen, "Power flow analysis of multi-terminal HVDC networks," in *PowerTech, 2011 IEEE Trondheim*, 2011, pp. 1-6.
- [29] T. M. Haileselassie and K. Uhlen, "Primary frequency control of remote grids connected by multi-terminal HVDC," in *Power and Energy Society General Meeting, 2010 IEEE*, 2010, pp. 1-6.
- [30] G. W. Stagg and A. H. El-Abiad, *Computer methods in power system analysis*. New York: McGraw-Hill, 1968.
- [31] DiGSILENT, "DiGSILENT PowerFactory, Version 15.2," 14.0.524.2 ed. Gomarigen, Germany, 2015.